


# SEGMENT 2: OAK 2 ROUTE

Route options are configured to go from the Sammamish substation in Redmond to the Talbot Hill substation in Renton and connect in the middle with the Richards Creek substation.

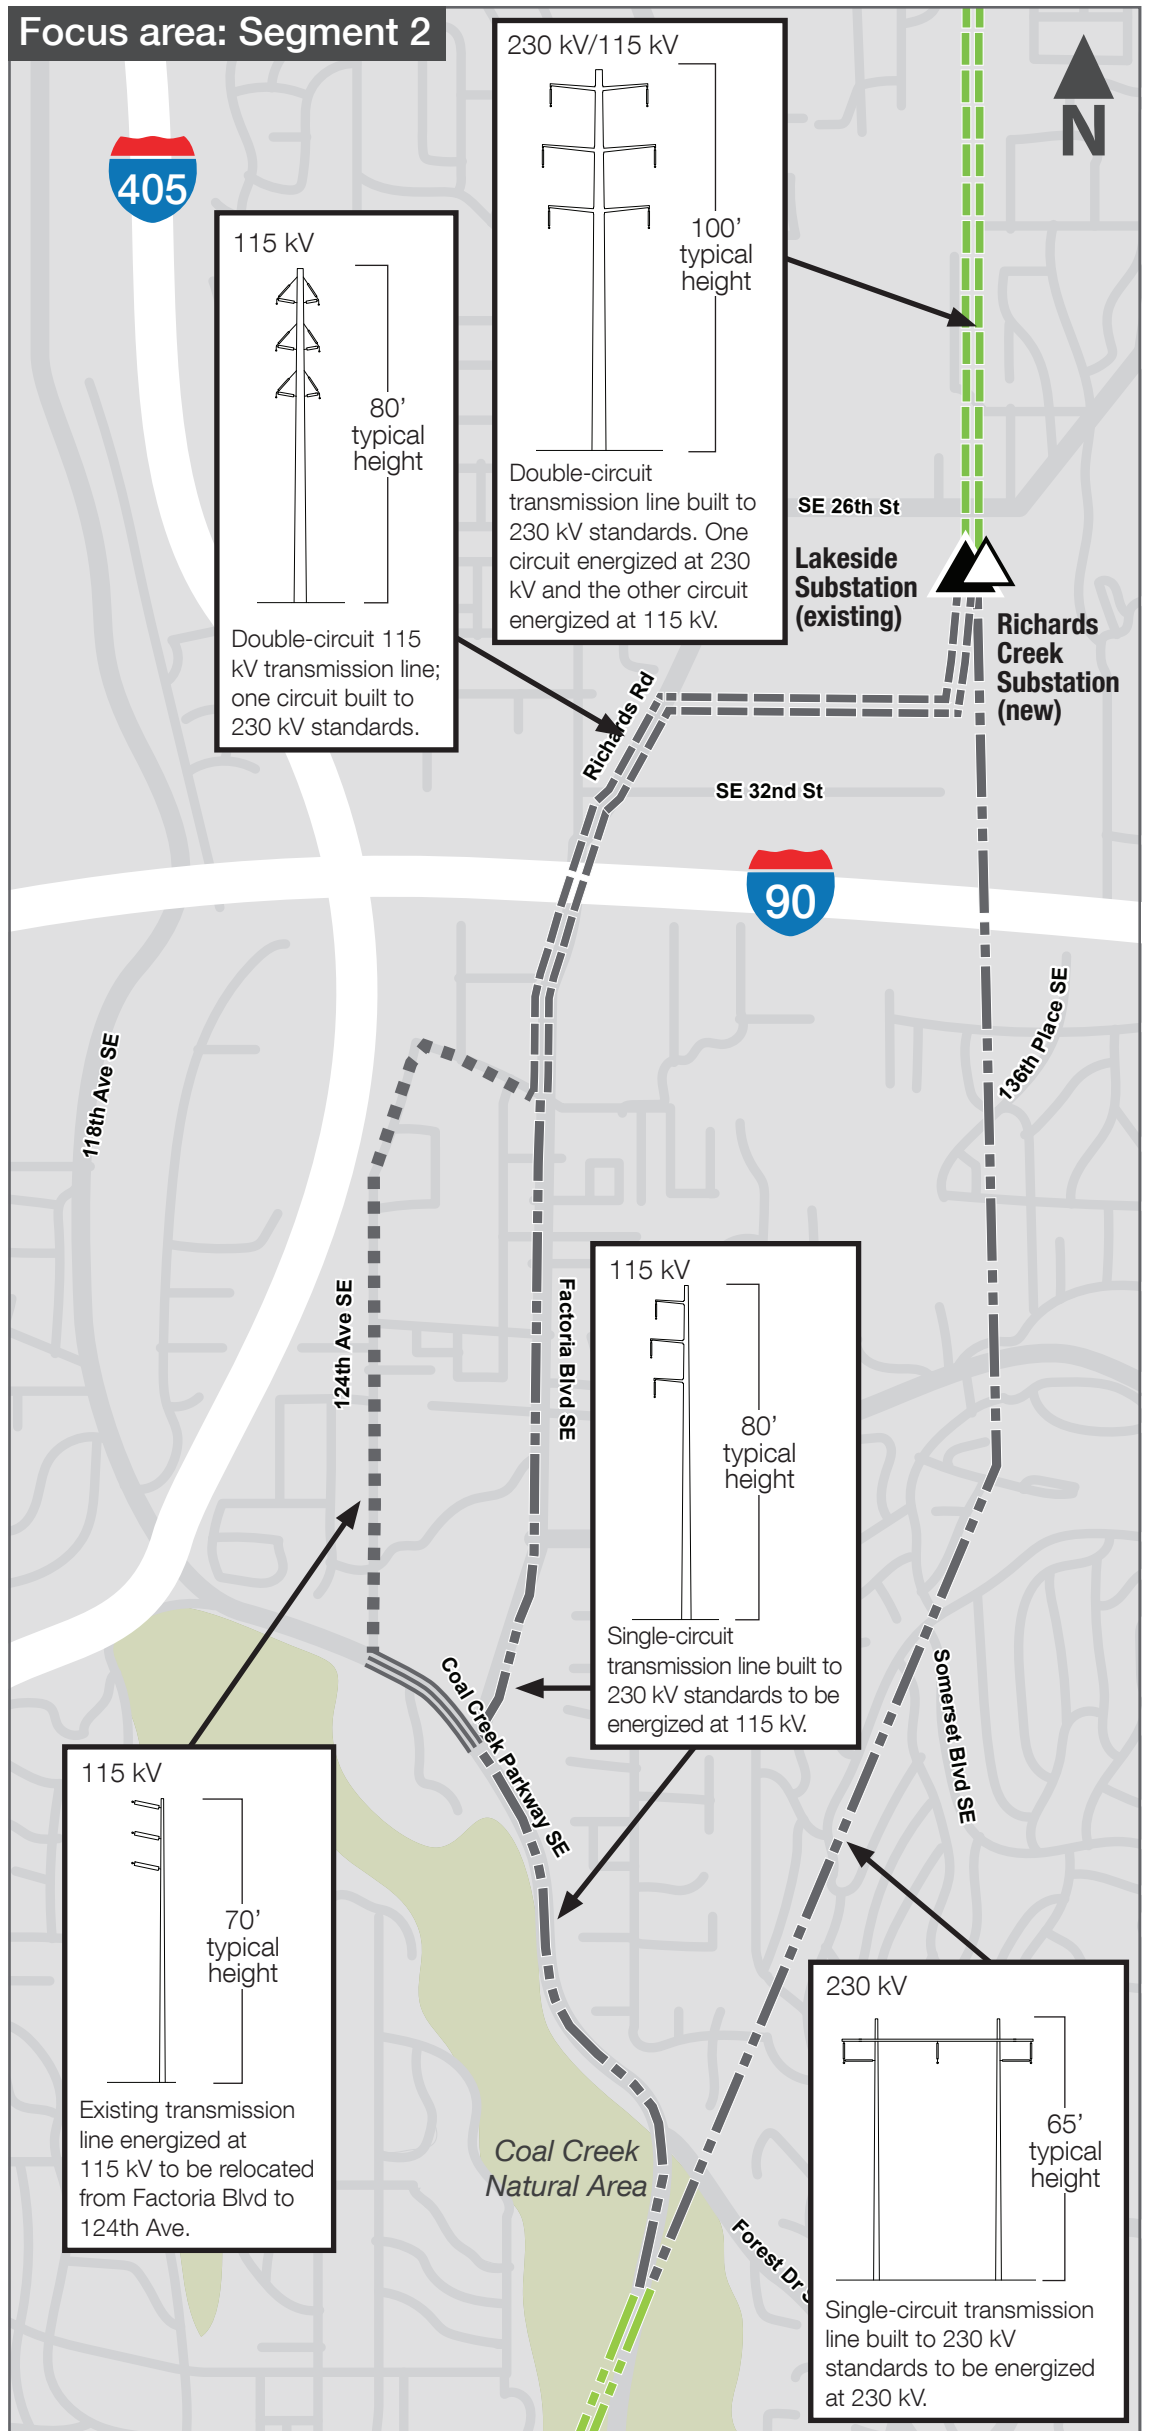

**NOTE:** These maps are for illustrative purposes only. Preliminary route, pole types, and pole heights are subject to change pending design, engineering, and environmental review. Poles may need to be taller in certain locations such as when crossing a highway.

### LEGEND

- Single-circuit transmission line
- Potential relocation routes for existing 115 kV transmission line
- Double-circuit transmission line
- Existing 115 kV transmission line to be removed
- Existing substation
- Substation undergoing additional analysis
- 1 3** Segments 1 and 3 are the same for all route options
- 2** Route options differ in Segment 2

**NOTE:** For all route options, Segments 1 and 3 are the same. Route options only differ in Segment 2.

May 2016